


Palm Springs Wastewater Treatment Plant COVID-19 Testing Test Results from November 28 & 29, 2022

Palm Springs is one of many agencies voluntarily sampling its wastewater for the detection of SARS-CoV-2. To do the test, the City takes 24-hour composite samples from the wastewater treatment plant and sends them via dry ice to GT Molecular, a testing laboratory in Fort Collins, Colorado, for analysis.

**City of Palm Springs Wastewater Treatment Plant
SARS-CoV-2 Concentration - Number of Viral Copies per Liter of Wastewater
Last 90 Days**

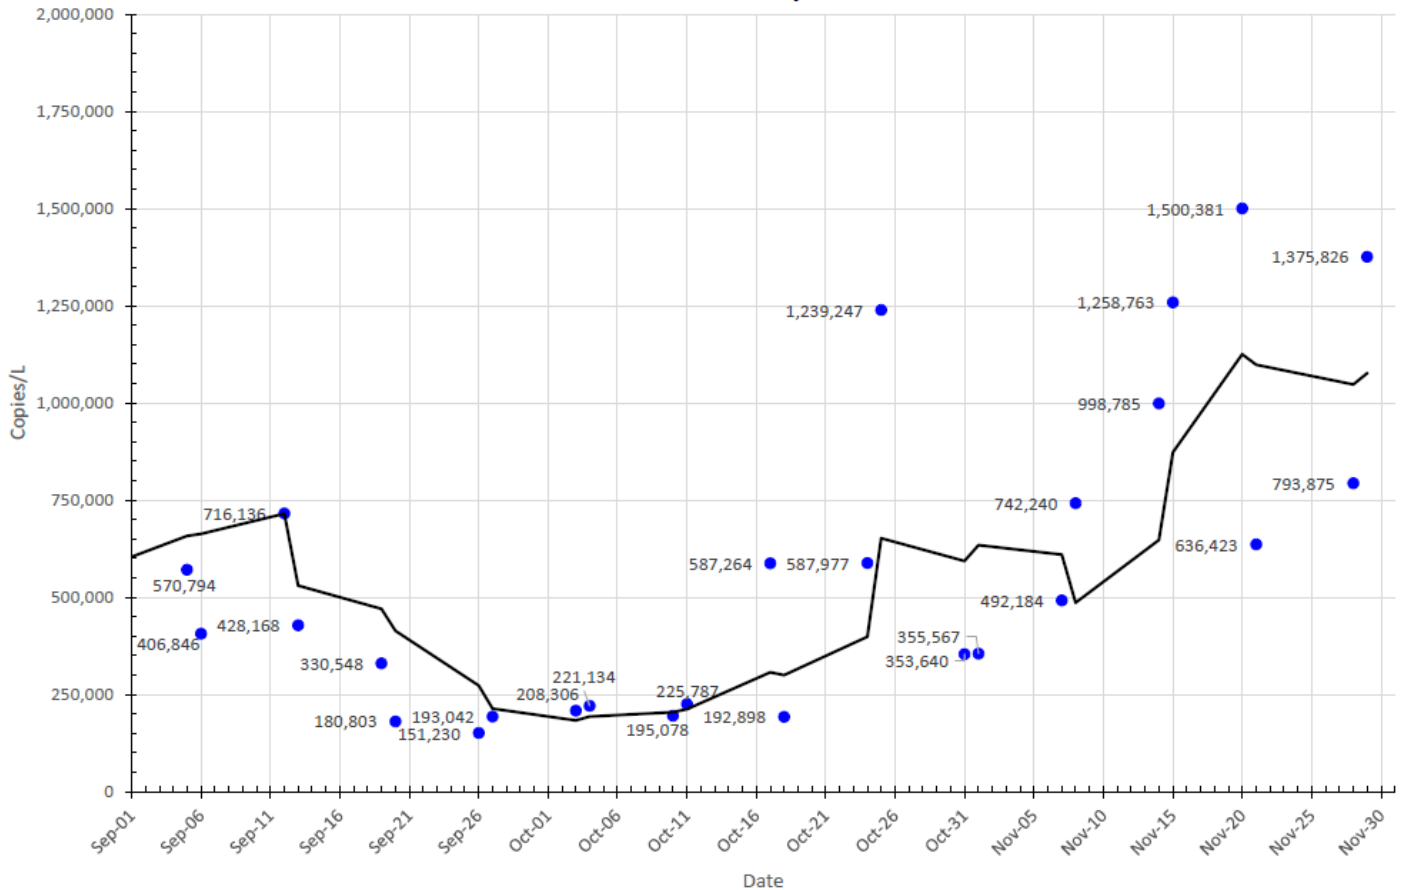

The average number of copies/L recorded at the City’s wastewater treatment plant increased slightly. The average of 1,068,402 copies/L from the previous week went up to an average of 1,084,851 copies/L for November 28 & 29, 2022.

Regarding Highly Transmissible Variants of Concern:

The lab is testing for variants and subvariants of concern. It does this by identifying associated signature mutations in the genes that encode the spike protein of the virus.


The Omicron BA.5 subvariant still appears to be the dominant subvariant circulating in the community.

Tracking Omicron subvariants

Date	%BA.1	% BA.4	%BA.5
10/31/22	0%	0.9%	77.6%
11/1/22	0%	0%	98.5%
11/7/22	0%	0.3%	88%
11/8/22	0%	0.4%	91.9%
11/14/22	0%	0%	95.9%
11/15/22	0.3%	0%	94.3%
11/20/22	0%	0.4%	80.6%
11/21/22	0%	0.3%	83.4%
11/28/22	0%	0%	80.6%
11/29/22	0%	1.7%	85.3%


Monthly Averages: Here are the monthly averages since we started testing in August 2020
 City of Palm Springs Wastewater Treatment Plant
 SARS-CoV-2 Concentration

Average Number of Viral Copies per Liter of Wastewater by Month

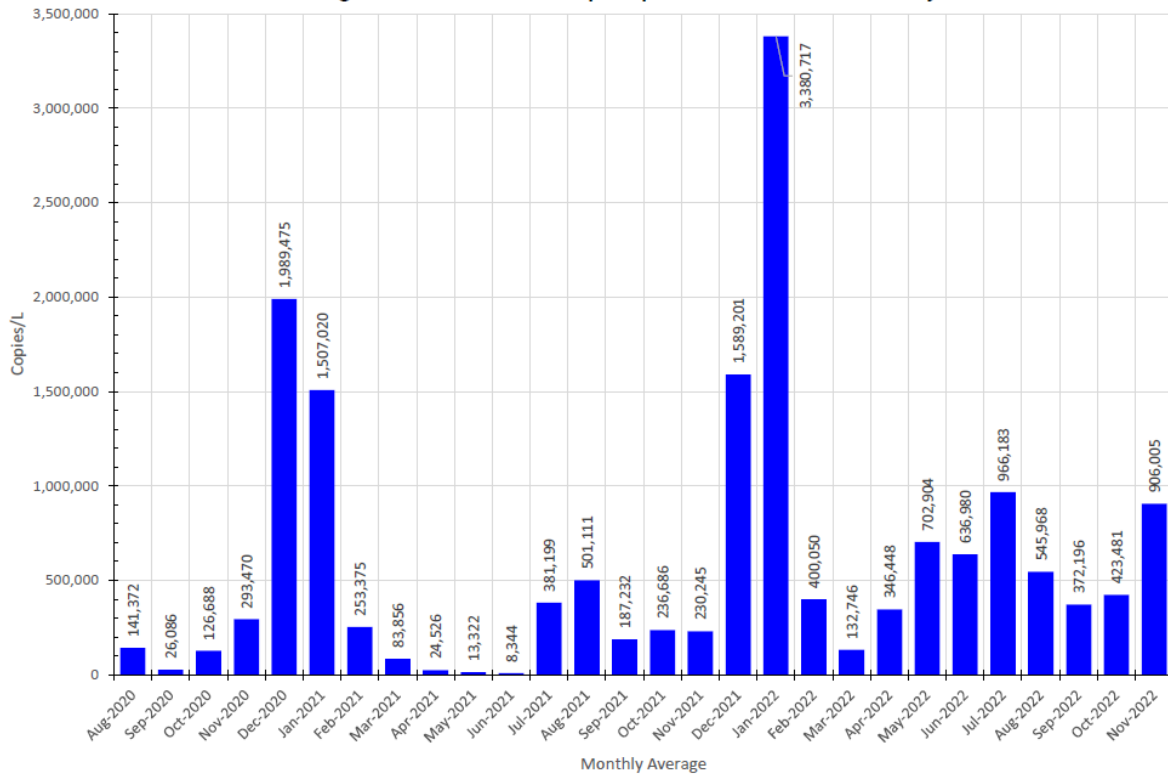


Full Data: Here is a historical look at the data we've collected throughout the pandemic.

City of Palm Springs Wastewater Treatment Plant SARS-CoV-2 Concentration Data
 Compared to California Reopening Tiers for Riverside County, State Requirements and
 Local Requirements

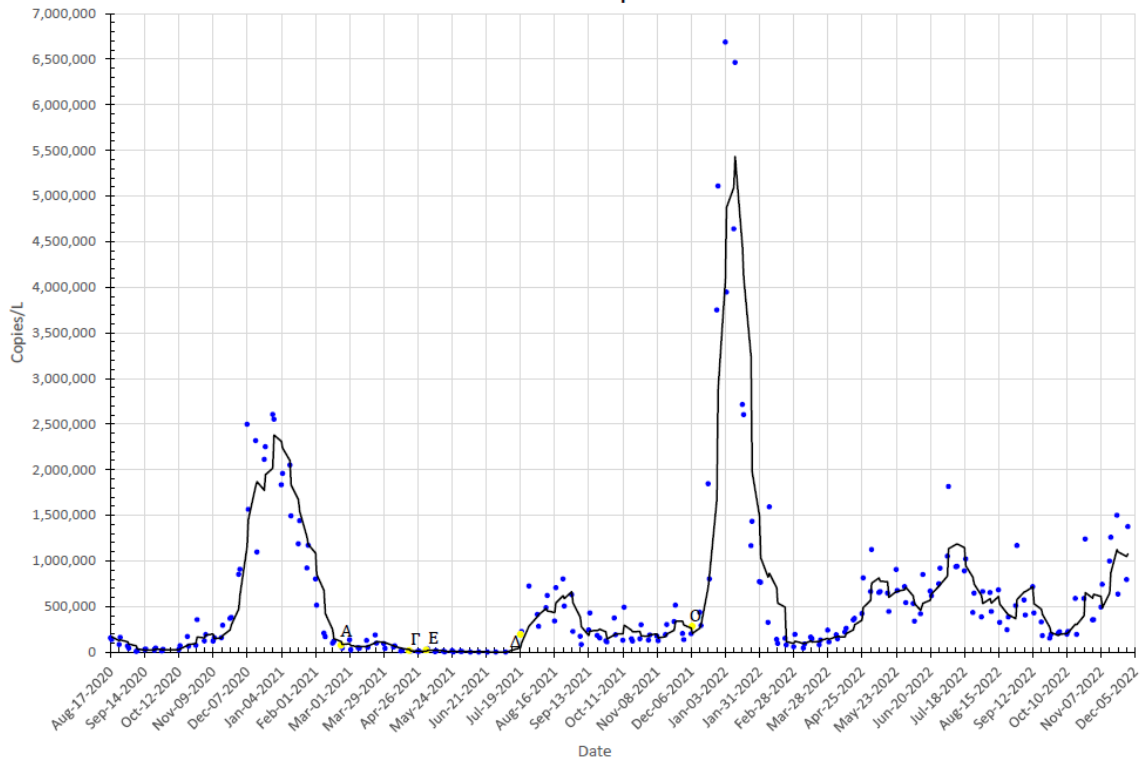

This is a comparison of the data for this year compared to the same time last year.

City of Palm Springs Wastewater Treatment Plant
SARS-CoV-2 Concentration - Number of Viral Copies per Liter of Wastewater
Comparison of the Last 90 Days to the Same Period in 2021

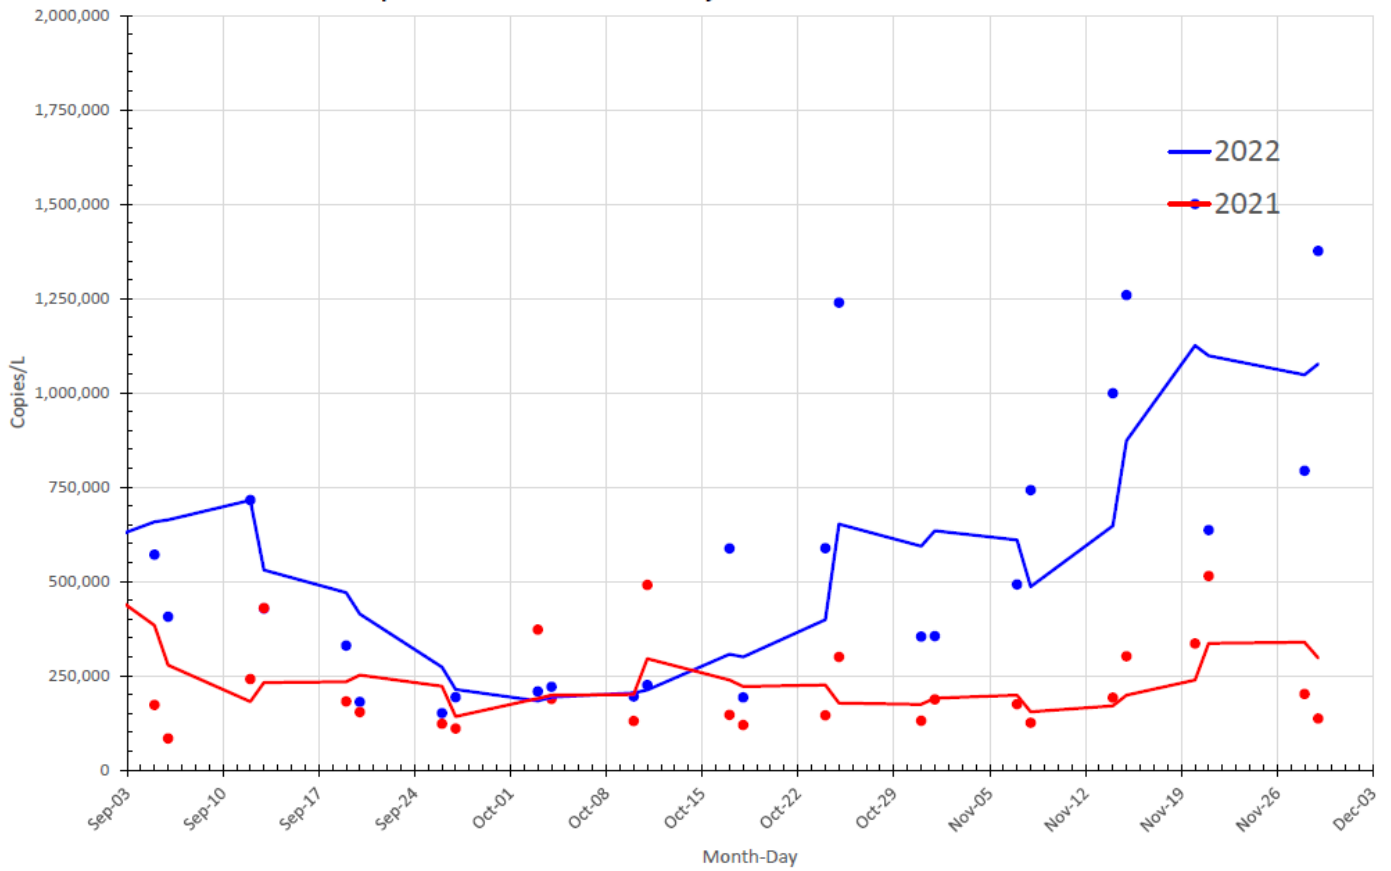

###