


NO.	REVISIONS	APPROVED	DATE

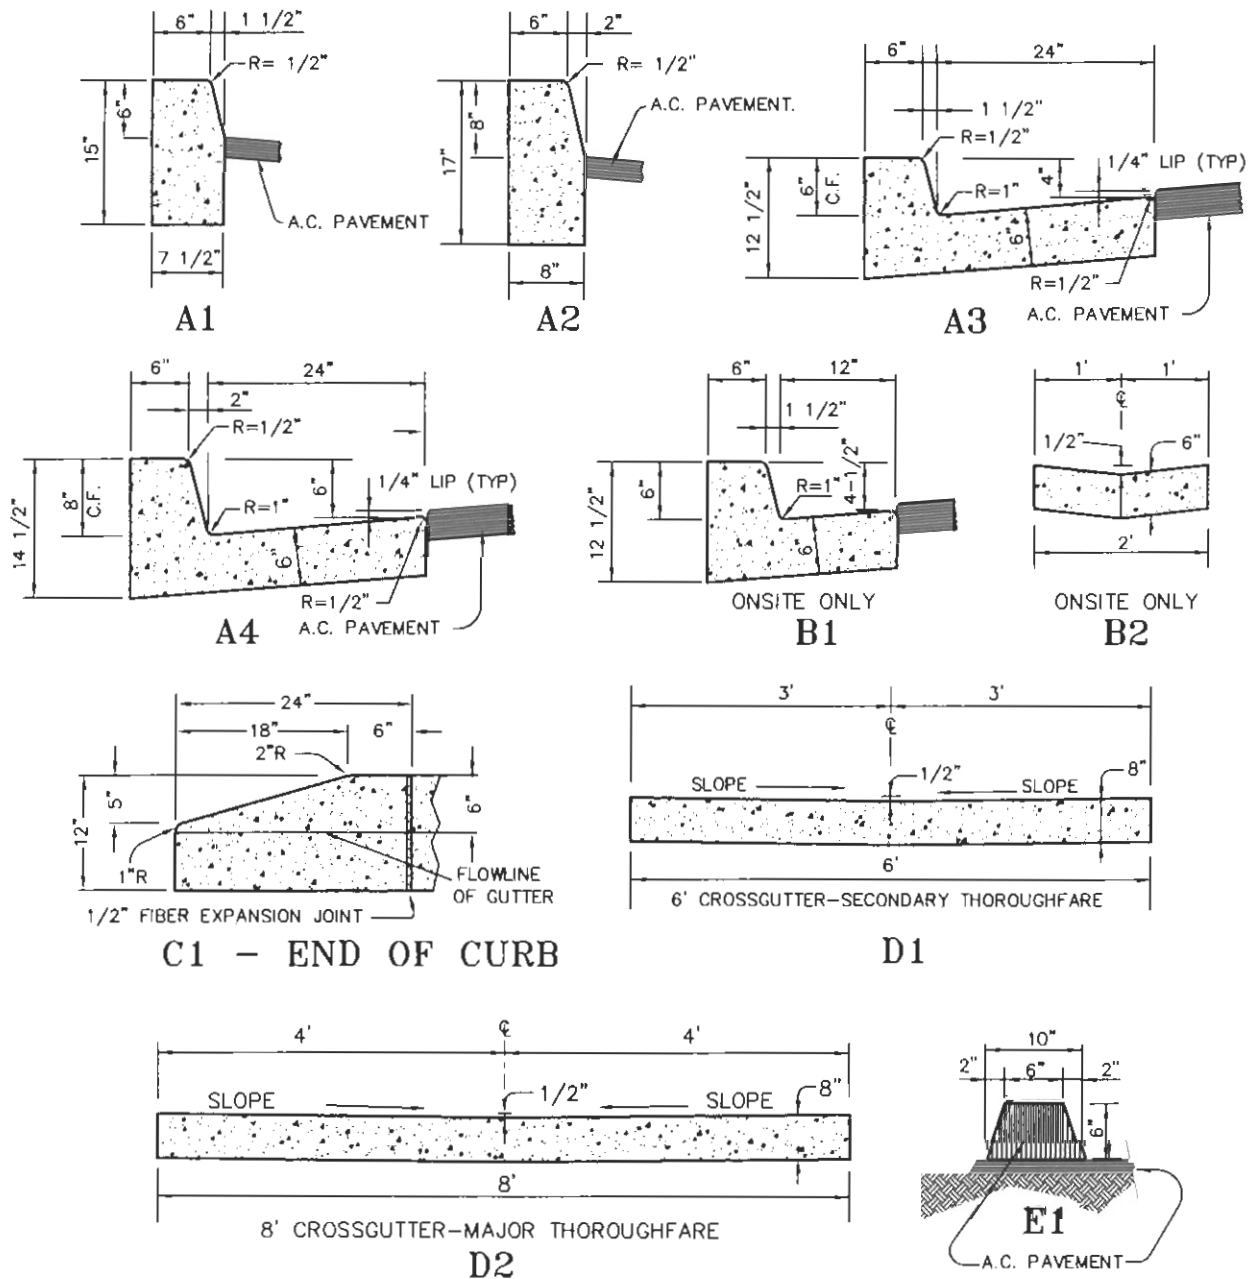

NOTES:

1. TYPES A1, A2 AND E1 ARE BARRIER CURBS.
2. TYPES A,B,C AND D ARE CONSTRUCTED OF CLASS 560-C-3250 PORTLAND CEMENT CONCRETE.
3. TYPE E1 IS CONSTRUCTED OF TYPE D2-AR8000 ASPHALT CONCRETE.
4. TYPE B CURB AND GUTTERS ARE FOR ONSITE USE ONLY.
5. ALL EXPOSED CORNERS ON P.C.C. CURBS AND GUTTERS SHALL BE ROUNDED WITH A 1/2" RADIUS.
6. EDGE OF A.C. PAVEMENT SHALL BE INSTALLED 1/4" ABOVE LIP OF GUTTER.
7. FOR EXPANSION AND WEAKENED PLANE JOINTS SEE SECTION 303-5.4 OF STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION. SCORING SHALL BE DONE EVERY 5 FEET MAXIMUM WITH 1" DEEP WEAKENED PLANE JOINTS PROVIDED EVERY 10 FEET.

CITY OF PALM SPRINGS PUBLIC WORKS & ENGINEERING DEPARTMENT	APPROVED: <i>[Signature]</i>	DATE: <i>[Signature]</i>
	CITY ENGINEER	28931 R.C.E.
CURBS, GUTTERS, AND CROSS-GUTTERS	DRAWN BY: G.F.F.	FILE NO. STANDARDS
	CHECKED BY: M.L.F.	DWG. NO. 200